NOTES BY SYMBOL "(#)"

1. 40/24 SUPPLY AND RETURN DUCT UP FROM BELOW WITHIN DUCT CHASE TO THE CEILING SPACE OF THE WORSHIP SPACE. OFFSET DUCTWORK IN VERTICAL RISE AS NECESSARY.

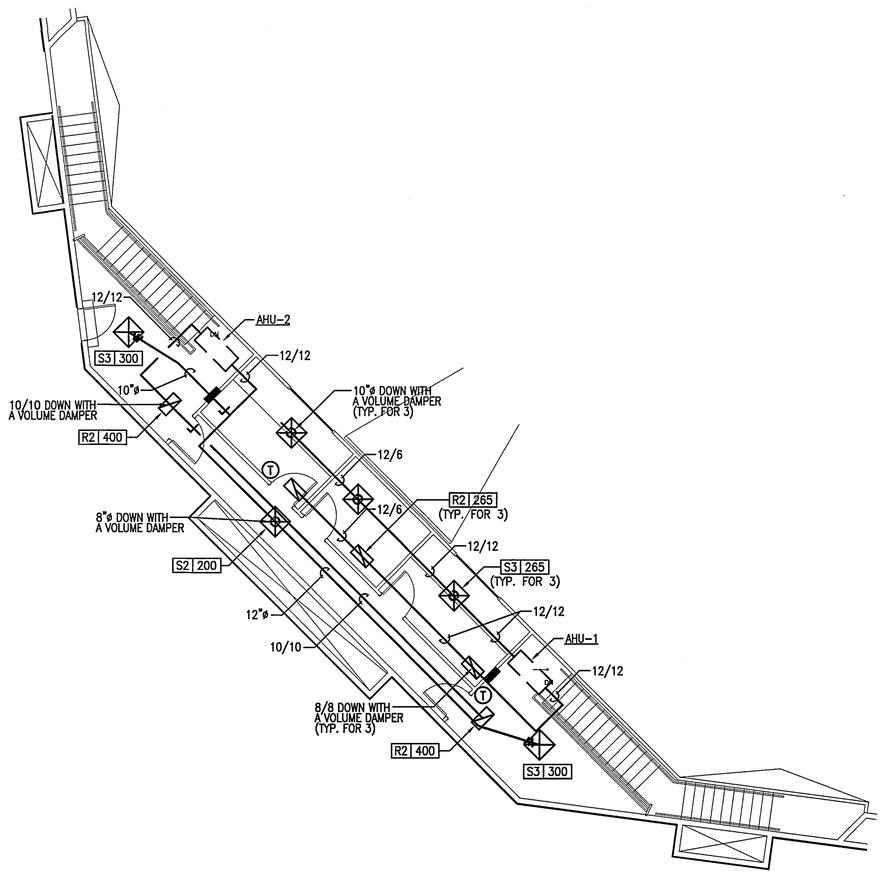

MECHANICAL PLAN – SECOND FLOOR (2 / M1.02)
1/8" = 1'-0"

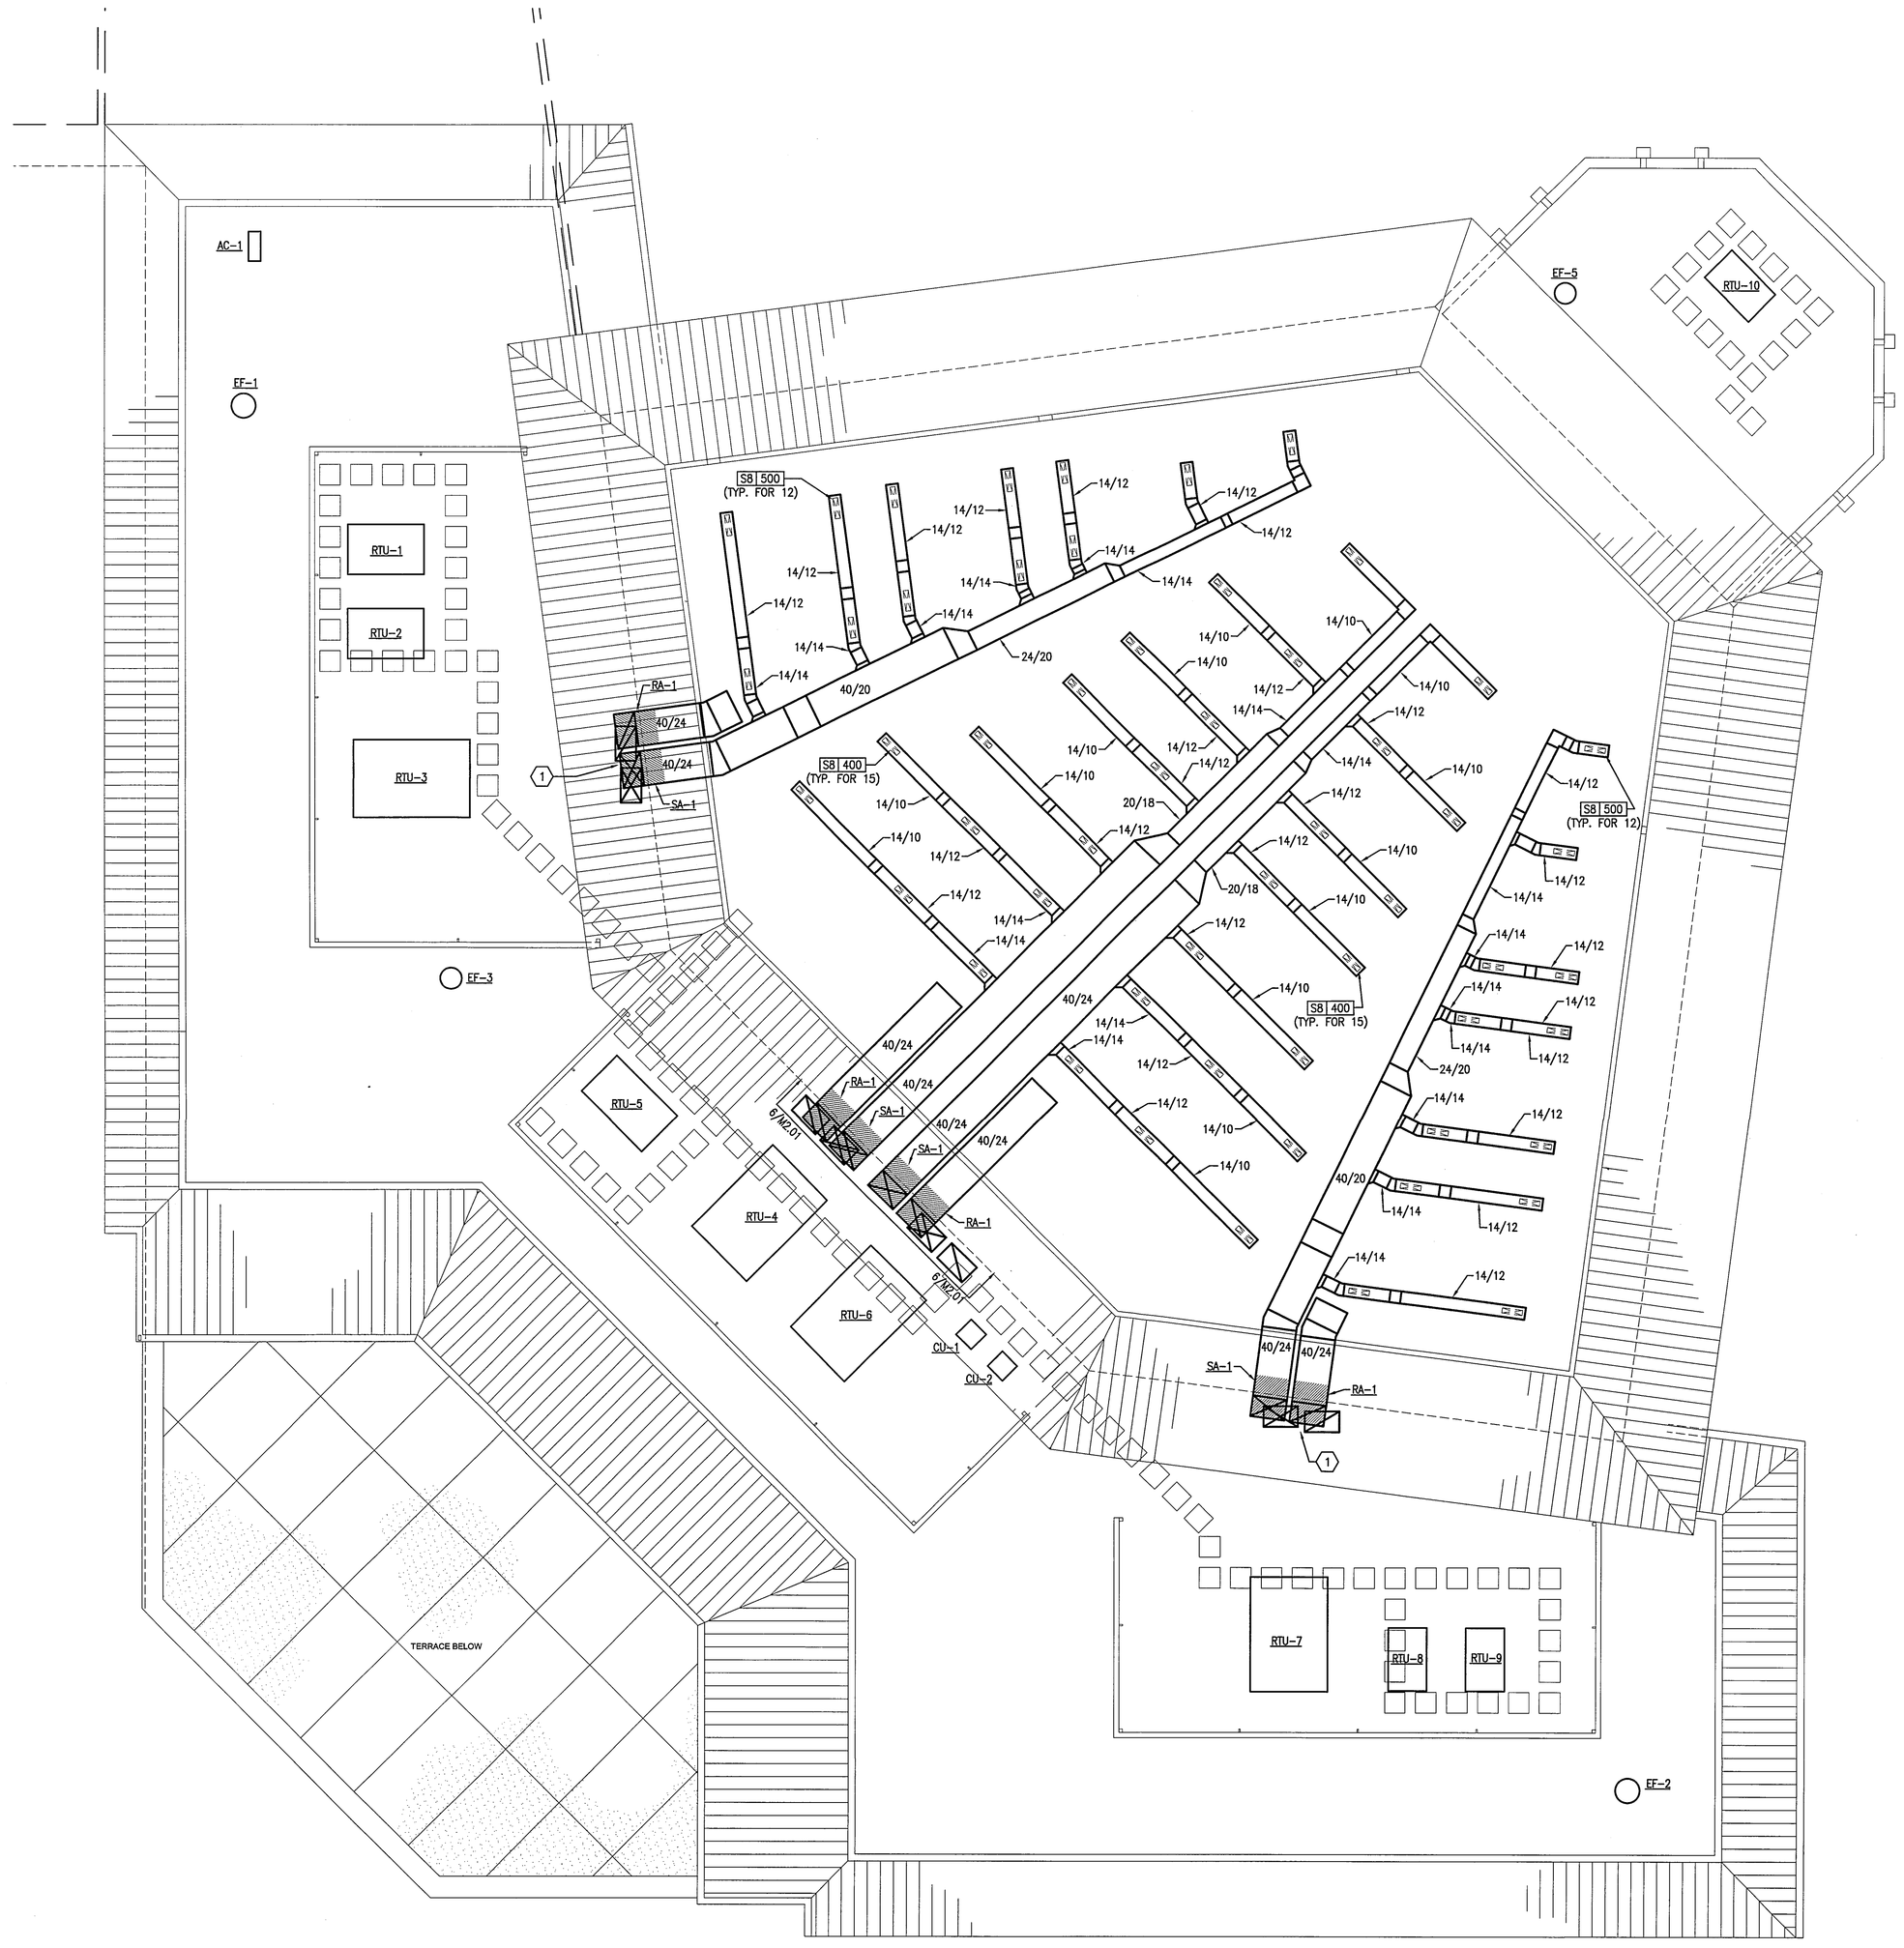

MECHANICAL PLAN – ROOF (1 / M1.02)
1/8" = 1'-0"

REGISTERED ARCHITECT R. CHRISTY HALLUM 3426 STATE OF TEXAS

Revisions:	By:

HALLUM ARCHITECTS, INC.
6040 CAMP BOWIE BLVD SUITE 17
FORT WORTH, TEXAS 76116
PHONE: 817.332.2422 FAX: 817.338.1949
email: info@hallumarch.com

NEW WORSHIP FACILITY

EAST SIDE CHURCH of CHRIST

MLK @ HWY 183, AUSTIN, TEXAS

MECHANICAL PLAN SECOND FLOOR AND ROOF

STATE OF TEXAS LESLIE R. BROWN 60171 REGISTERED PROFESSIONAL ENGINEER 3-7-08

Baird, Hampton & Brown, Inc.
Engineering & Surveying
6300 Ridglea Pl., Ste. 700 Ft. Worth, TX 76116 Tel (817)336-1277 Fax (817)336-9245 E-mail:mep@bhbinc.com

BHB PROJECT # 2006.172.000

© Copyright 2007 By Hallum Architects, Inc. - ALL RIGHTS RESERVED

Date:	03-07-08
Scale:	PER PLAN
Drawn:	GHM
Job:	2006-05
Sheet Number:	M1.02

AUDITORIUM