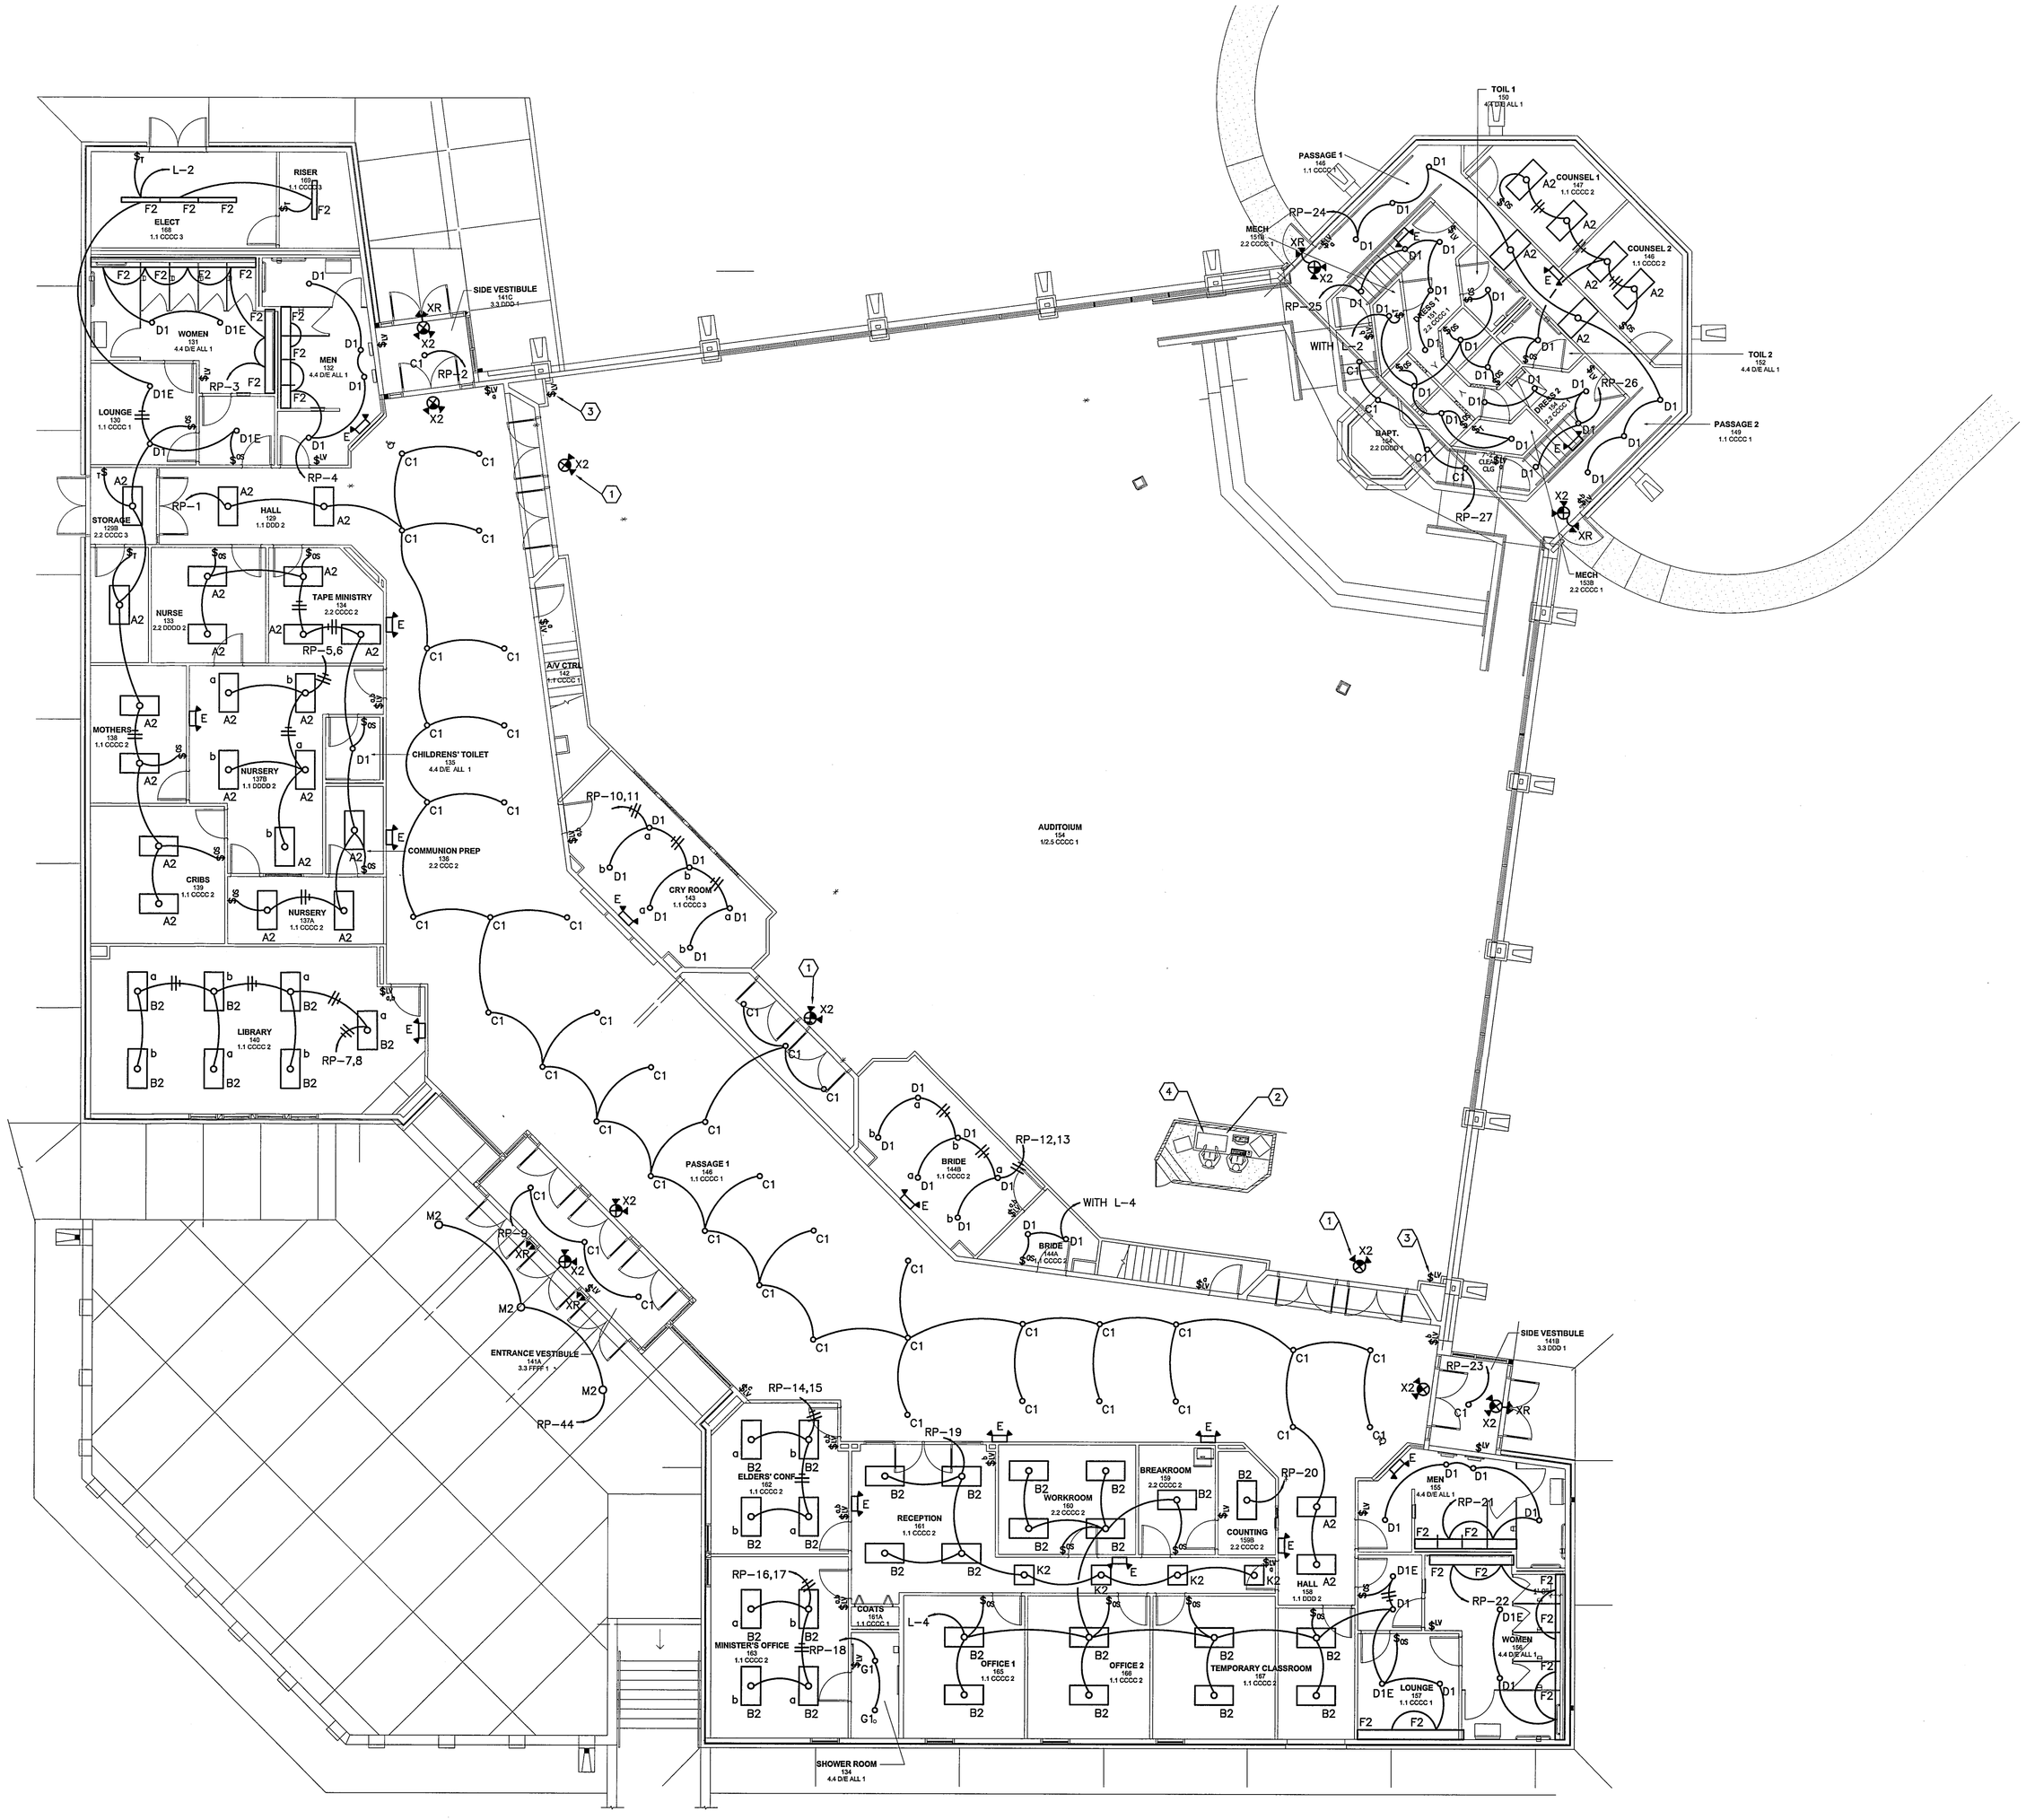

N

01 LIGHTING PLAN - FIRST FLOOR
SCALE: 1/8" = 1'-0"

NOTES BY SYMBOL " ⬡ "

1. CONNECT ALL SANCTUARY EXIT/EMERGENCY LIGHTING THRU DIMMING PANEL SUCH THAT EXIT/EMERGENCY LIGHTING SHALL BE ENERGIZED ON LOSS OF POWER TO THE DIMMING PANEL.
2. GRAPHIC EYE 4000 SERIES 12 SCENE CONTROLLER. INSTALL 1 1/2" CONDUIT TO DIMMING PANEL.
3. 4-BUTTON LOW VOLTAGE REMOTE SCENE CONTROLLER FOR HOUSEKEEPING LIGHTING CONTROL.
4. INSTALL (2) 1-1/2" CONDUIT TO EACH AV CONTROL BOOTH ON SECOND FLOOR FOR FUTURE LIGHTING CONTROLS.

GENERAL NOTES:

1. REFER TO SHEET E3.01 FOR LIGHTING FIXTURE SCHEDULE, RISER DIAGRAM AND ELECTRICAL SYMBOLS.
2. REFER TO SHEET E3.02 FOR PANELBOARD SCHEDULES AND RELAY PANEL SCHEDULE.
3. PAINT ALL EXPOSED CONDUIT TO MATCH ADJACENT FINISHES.
4. CONNECT ALL EMERGENCY/EXIT LIGHTING NOT SHOWN CONNECTED, TO LOCAL CIRCUITS AHEAD OF SWITCHING.
5. PROVIDE SEPARATE UNSWITCHED HOT CONDUCTOR FOR ALL RELAY PANEL CIRCUITS WITH EMERGENCY/EXIT LIGHTING. EMERGENCY BATTERIES/BALLASTS SHALL REMAIN ENERGIZED WHEN CIRCUIT IS DE-ENERGIZED BY RELAY PANEL.
6. BRANCH CIRCUITS SHALL NOT EXCEED A MAXIMUM VOLTAGE DROP OF 3 PERCENT. REFER TO SPECIFCATION SECTION 16120, 2.1, C FOR MINIMUM WIRE SIZES.

Baird, Hampton & Brown, Inc.
Engineering & Surveying
6300 Ridgea Pl., Ste. 700 Ft. Worth, TX 76116 Tel (817)338-1277 Fax (817)338-8265 E-Mail:mail@bhbinc.com

BHB PROJECT # 2006.172.000

© Copyright 2007 By Hallum Architects, Inc. - ALL RIGHTS RESERVED

STATE OF TEXAS
MERLIN HAMPTON
38416
REGISTERED ARCHITECT
3-7-08

Revisions:	By:

HALLUM ARCHITECTS, INC.
6040 CAMP BOWIE BLVD SUITE 17
FORT WORTH, TEXAS 76116
PHONE: 817.332.2422 FAX: 817.338.1949
email: info@hallumarch.com

NEW WORSHIP FACILITY

EAST SIDE CHURCH of CHRIST

MLK @ HWY 183, AUSTIN, TEXAS

LIGHTING PLAN - FIRST FLOOR

Date:	03-07-08
Scale:	PER PLAN
Drawn:	SG
Job:	2006-05
Sheet Number:	E 1.01

AUDITORIUM