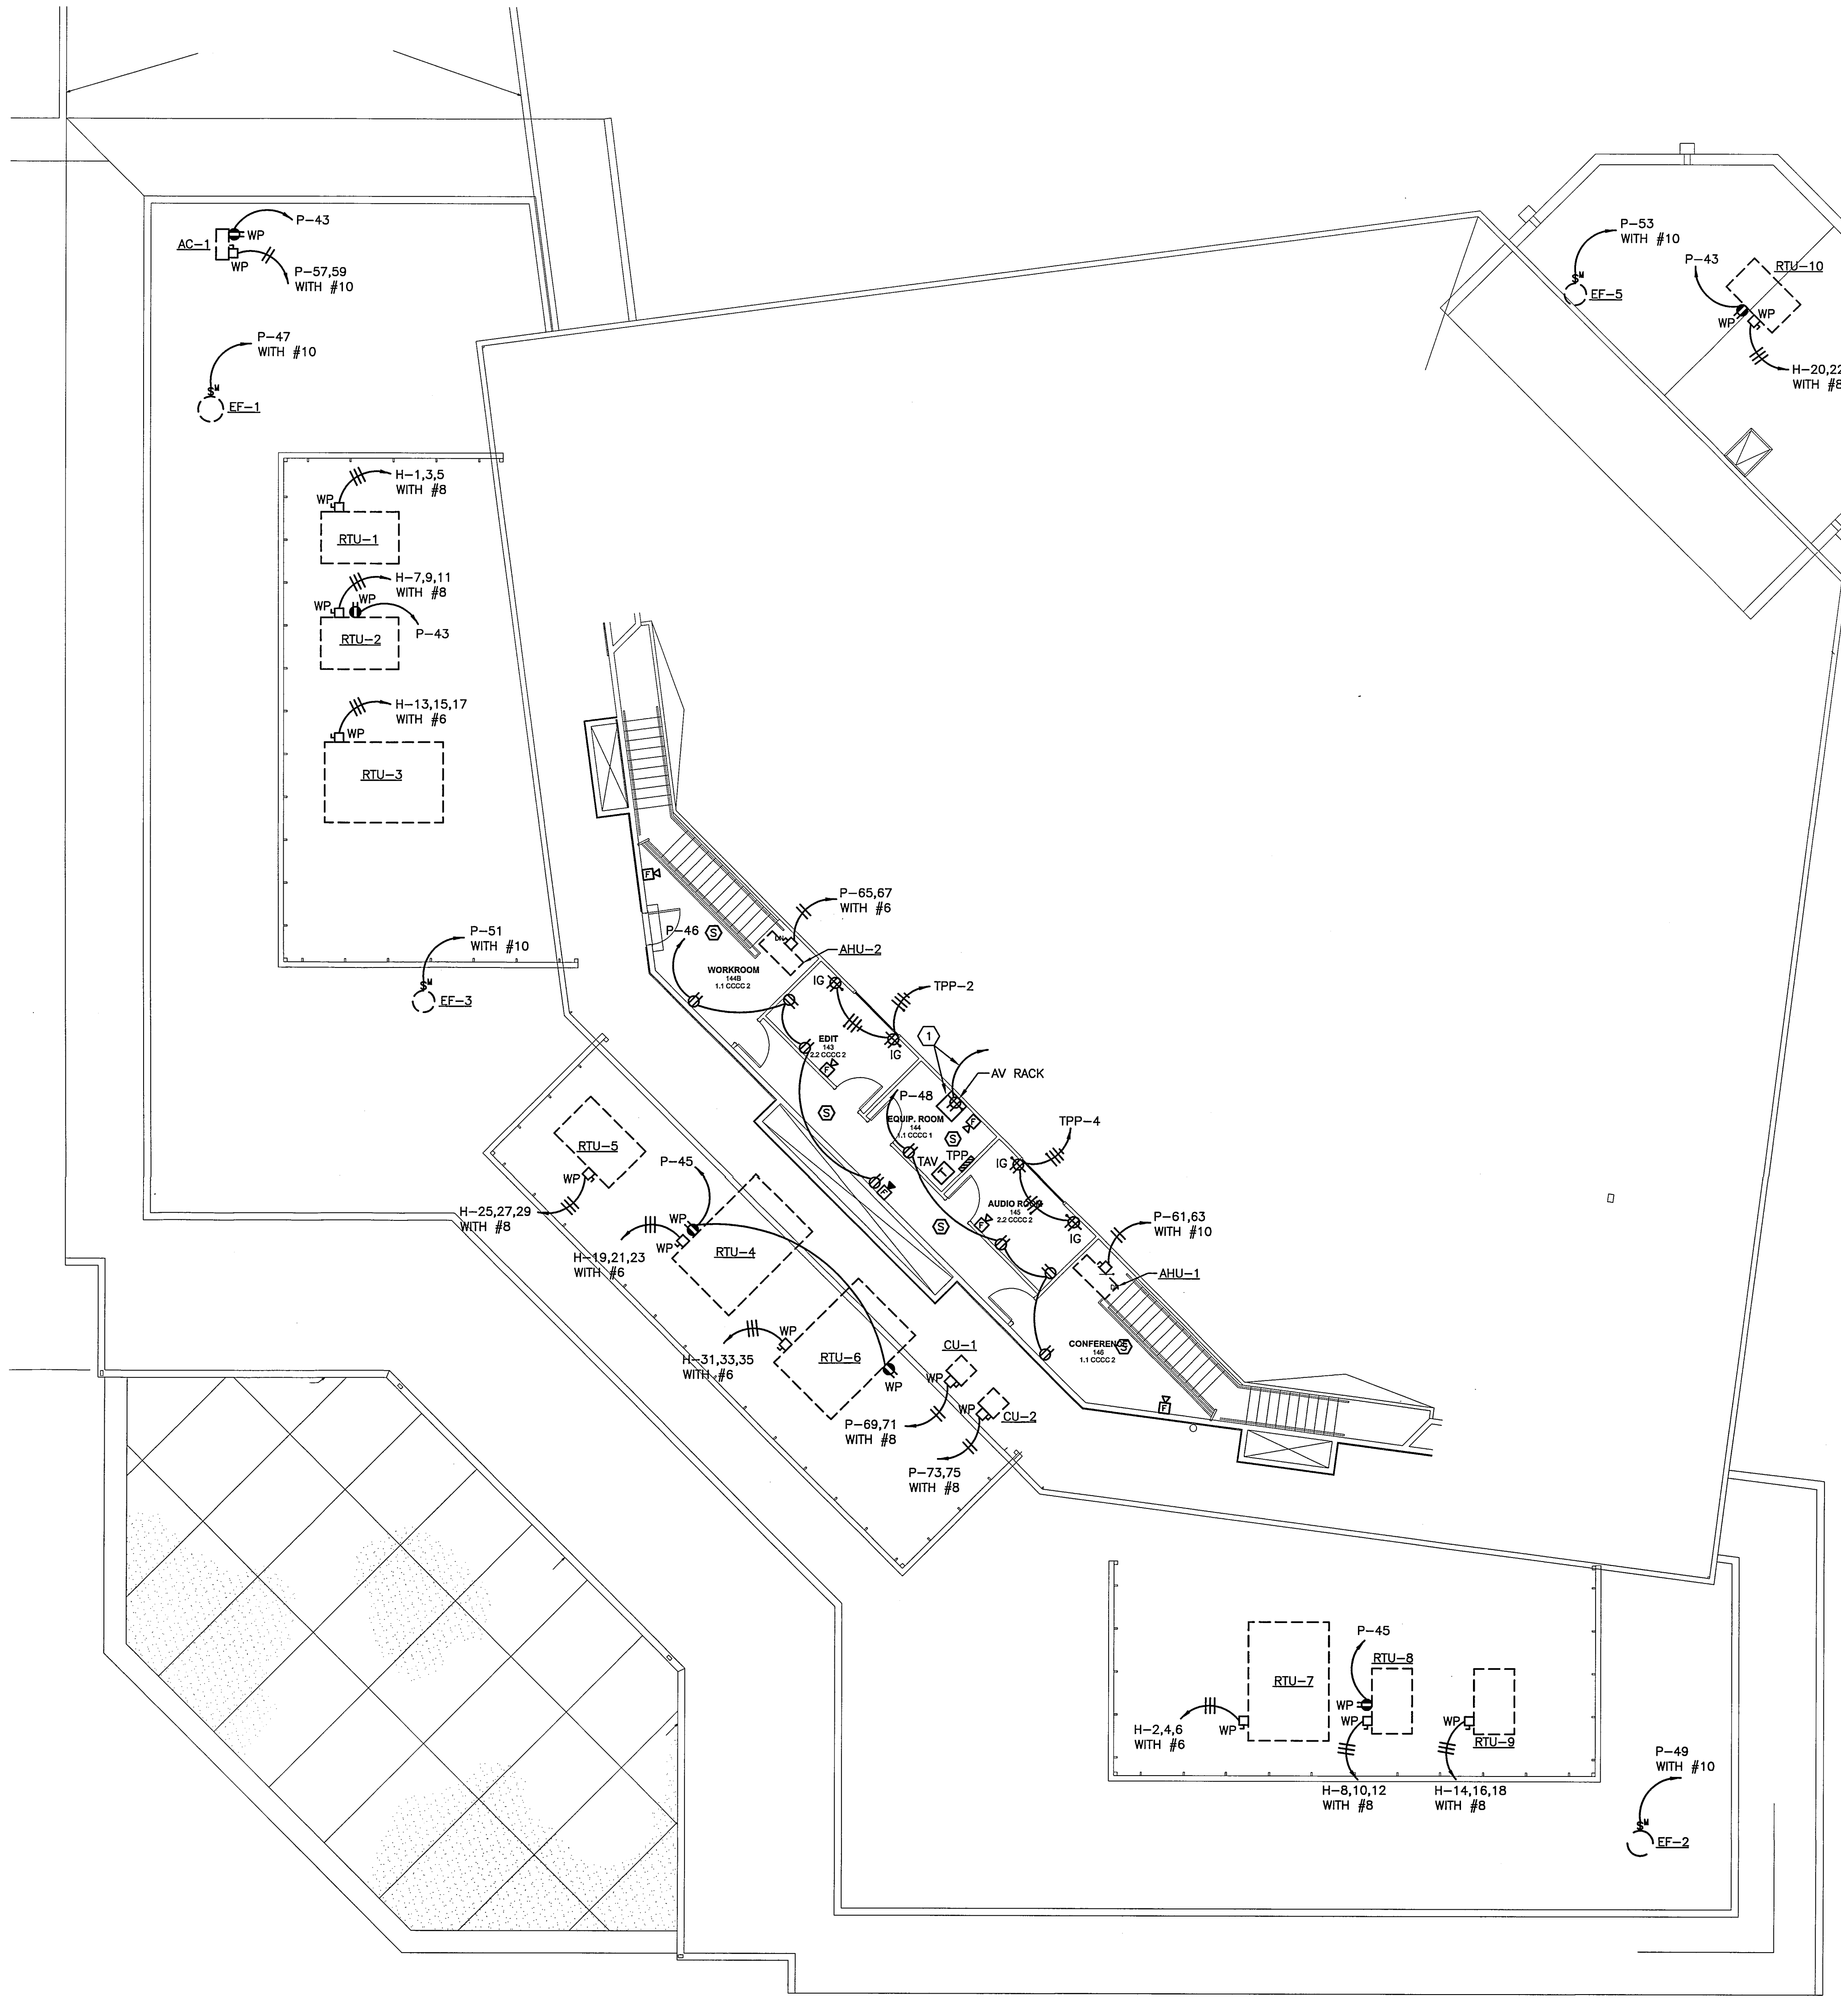

N

01 POWER PLAN - SECOND FLOOR

SCALE: 1/8" = 1' - 0"

NOTES BY SYMBOL " ⬡ "

1. INSTALL SIX (6) ISOLATED GROUND CIRCUITS TO PANEL 'TPP' WITH DEDICATED NEUTRALS AND ISOLATED GROUNDS.

GENERAL NOTES:

1. REFER TO SHEET E3.01 FOR RISER DIAGRAM AND ELECTRICAL SYMBOLS.
2. REFER TO SHEET E3.02 FOR PANELBOARD SCHEDULES.
3. VERIFY QUANTITIES AND LOCATIONS FOR ALL A/V DEVICES WITH A/V CONSULTANT/SUPPLIER PRIOR TO CONTRUCTION. REFER TO AV DRAWINGS FOR ADDITIONAL INFORMATION AND ADDITIONAL CONDUIT REQUIREMENTS.
4. PAINT ALL EXPOSED CONDUIT/RACEWAY TO MATCH ADJACENT FINISHES.
5. BRANCH CIRCUITS SHALL NOT EXCEED A MAXIMUM VOLTAGE DROP OF 3 PERCENT. REFER TO SPECIFCATION SECTION 16120, 2.1, C FOR MINIMUM WIRE SIZES.

REGISTERED ARCHITECT MARK T. HALLUM 2408 STATE OF TEXAS

Revisions:	By:

HALLUM ARCHITECTS, INC.
6040 CAMP BOWIE BLVD SUITE 17
FORT WORTH, TEXAS 76116
PHONE: 817.332.2422 FAX: 817.338.1949
email: info@hallumarch.com

NEW WORSHIP FACILITY

EAST SIDE CHURCH of CHRIST

MLK @ HWY 183, AUSTIN, TEXAS

POWER PLAN - SECOND FLOOR

STATE OF TEXAS MERLIN HAMPTON 38416 REGISTERED PROFESSIONAL ENGINEER 3-7-08

Baird, Hampton & Brown, Inc.
Engineering & Surveying
6300 Ridgea Pl., Ste. 700 Ft. Worth, TX 76116 Tel (817)338-1277 Fax (817)338-9245 E-Mail:mep@bhbinc.com

BHB PROJECT # 2006.172.000

Date:	03-07-08
Scale:	PER PLAN
Drawn:	SG
Job:	2006-05
Sheet Number:	E2.02

AUDITORIUM

© Copyright 2007 By Hallum Architects, Inc. - ALL RIGHTS RESERVED